




Basic Magnetic Locking System

(Shown with optional Access Control Keypad - see pp. 35-37)

Application - Any exit door where free egress is permitted.

Outside Operation - The door is secured via the M32/M62 Magnalock. Entry is permitted using an optional entry device which releases the magnetic lock.

Inside Operation - The door is secured via the Magnalock. Free egress is accomplished by pushing on the TSB-3 which de-energizes the lock. Contact the factory for additional exit devices necessary for fire-rated installations.

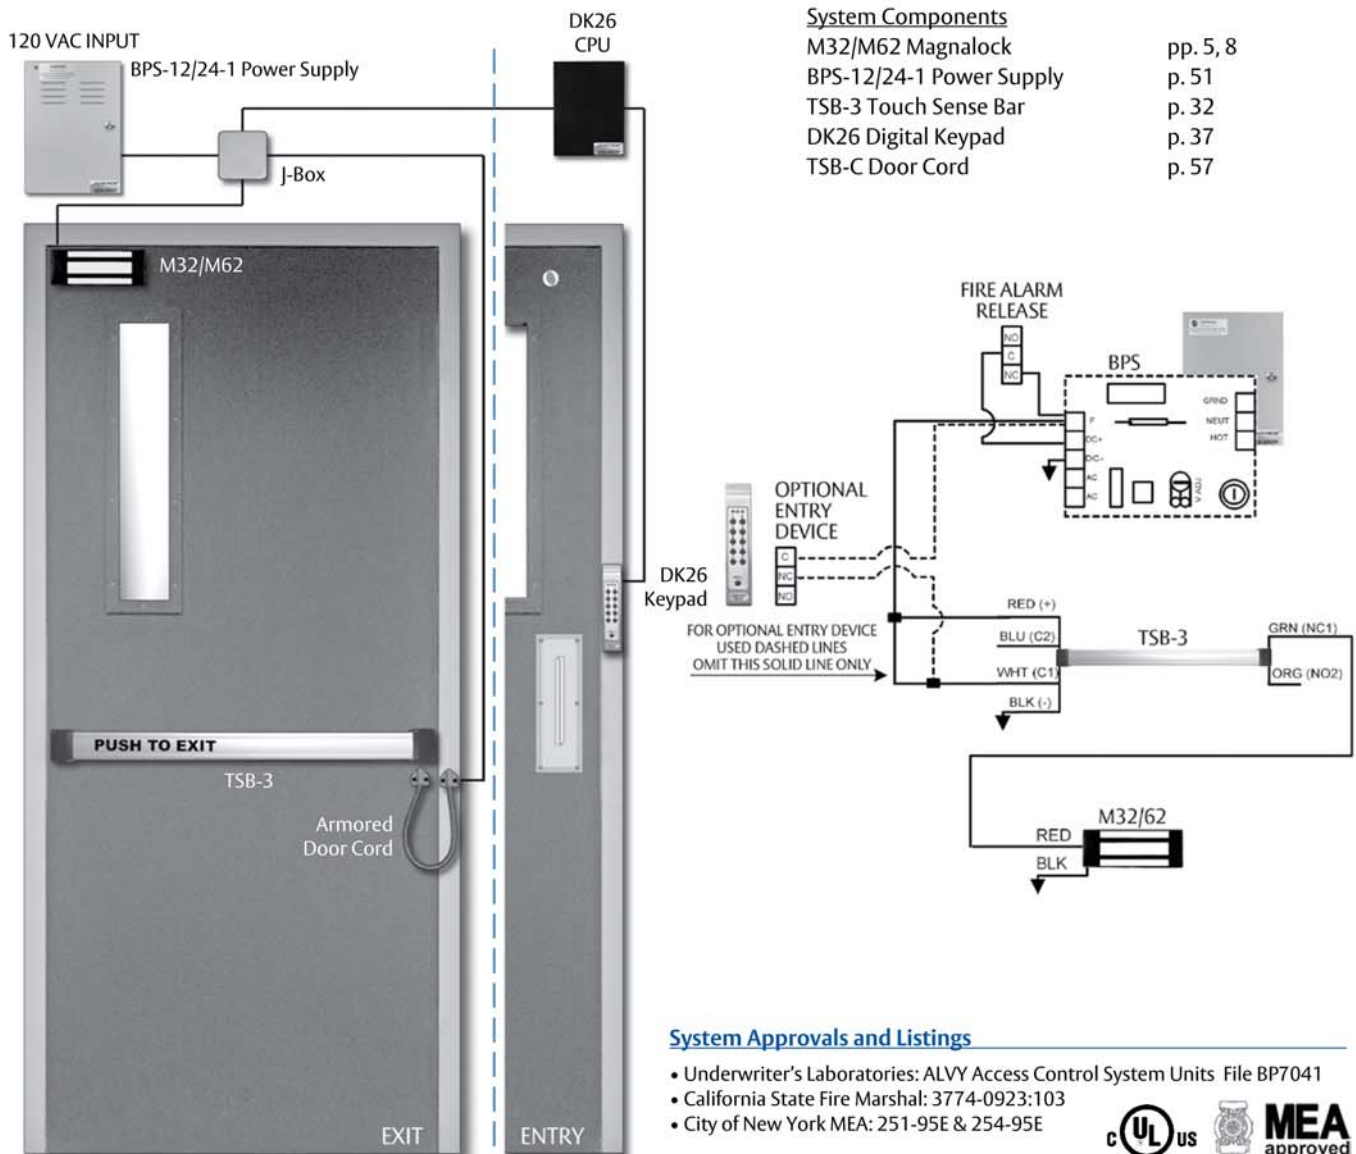

System Components

- M32/M62 Magnalock pp. 5, 8
- BPS-12/24-1 Power Supply p. 51
- TSB-3 Touch Sense Bar p. 32
- DK26 Digital Keypad p. 37
- TSB-C Door Cord p. 57

System Approvals and Listings

- Underwriter's Laboratories: ALVY Access Control System Units File BP7041
- California State Fire Marshal: 3774-0923:103
- City of New York MEA: 251-95E & 254-95E

